




AK Fire Marshal Review No. 2006-0076

CONSTRUCTION DOCUMENTS
**SKAGWAY BAZAAR BUILDING
 REMODEL**

6th Avenue & Broadway
 Skagway, Alaska 99840

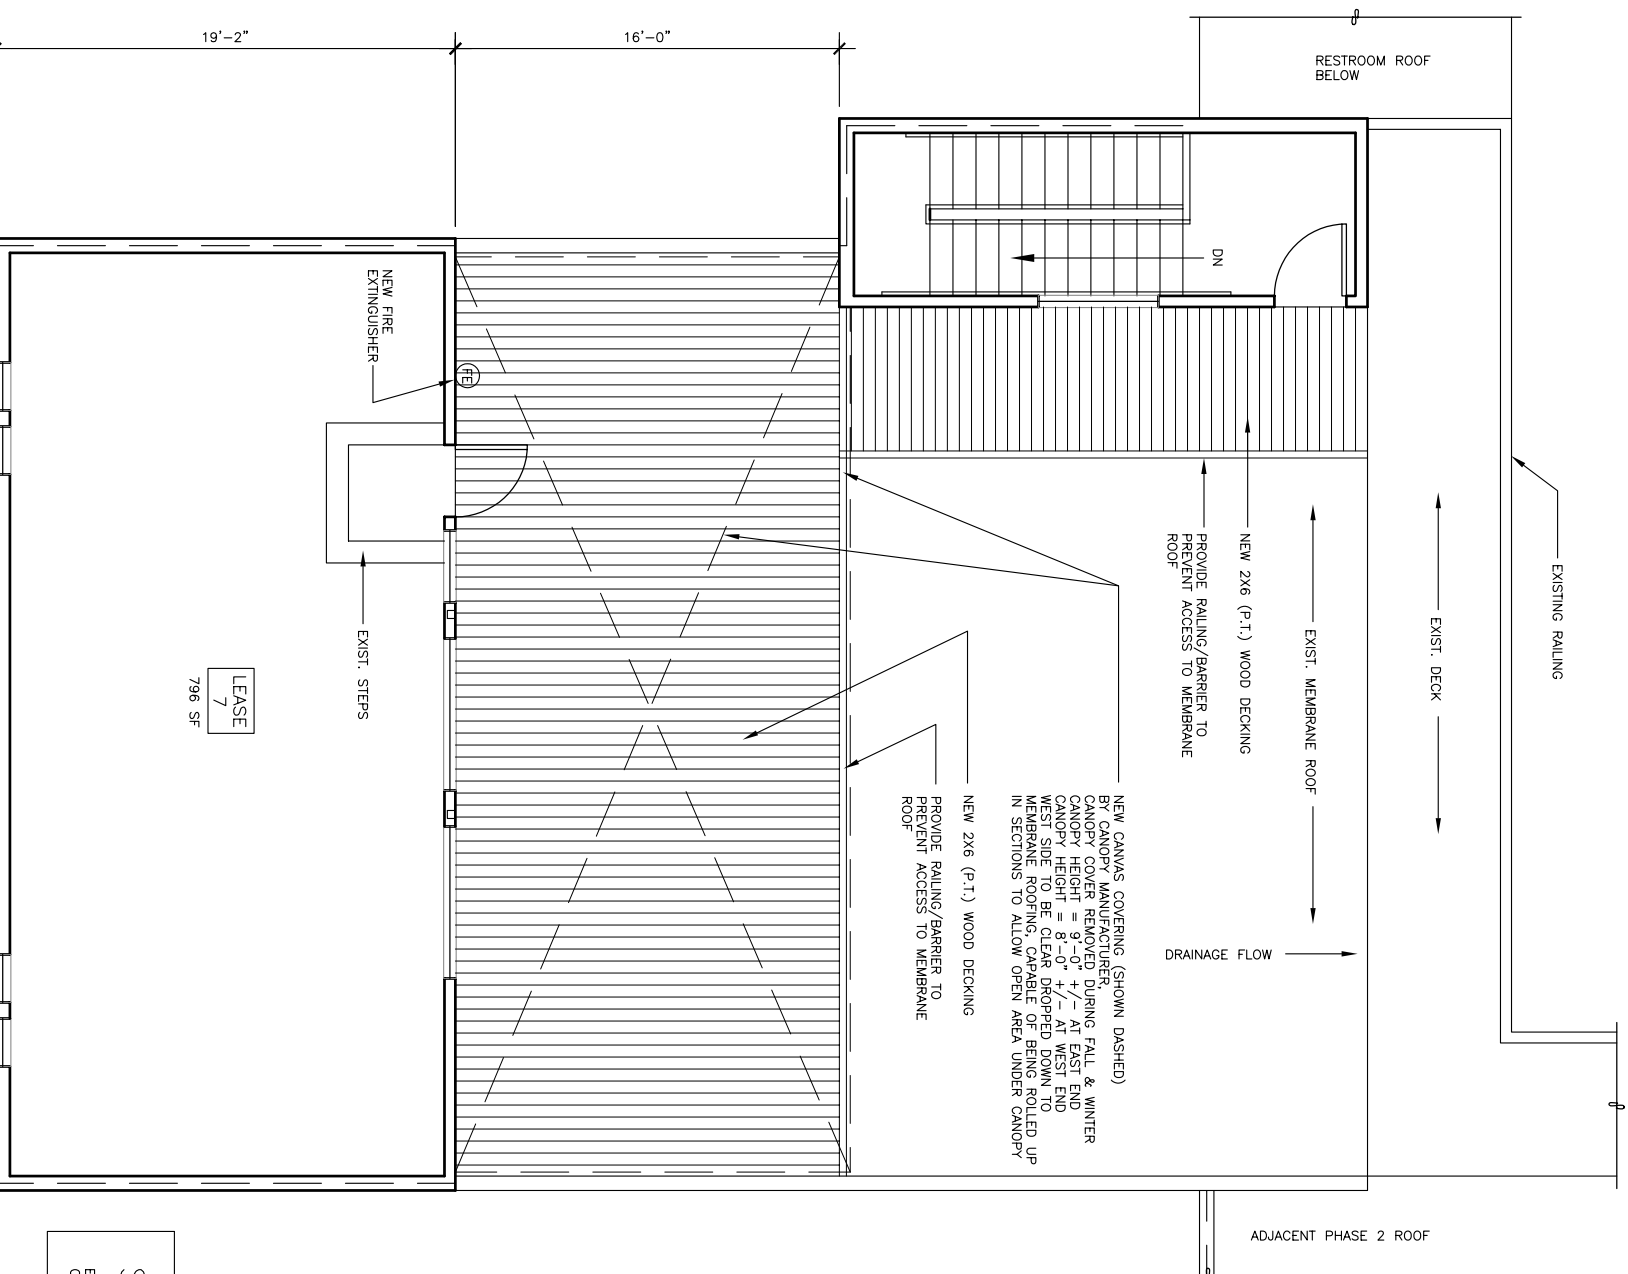

A NEW CANOPY & DECK 2ND FLR
 SCALE: 1/4" = 1'-0"
 D:\CAD\0602

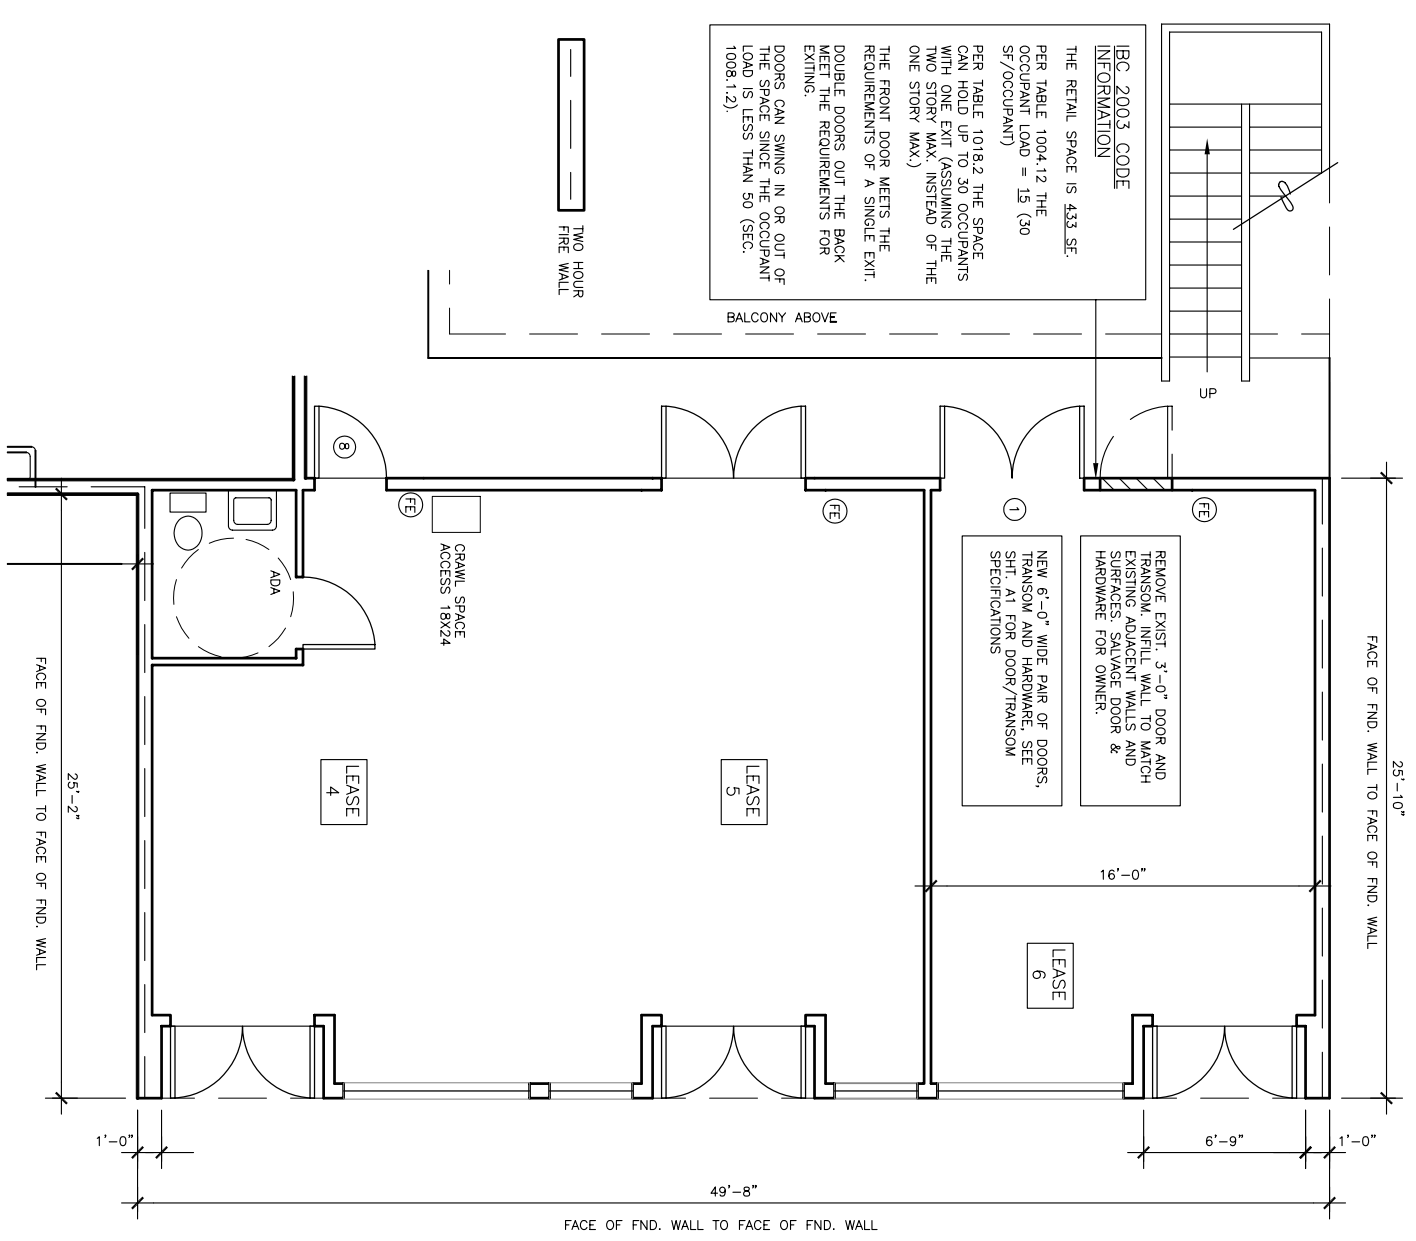


B NEW PAIR OF DOORS 1ST FLR
 SCALE: 1/4" = 1'-0"
 D:\CAD\0602

CANOPY SPECIFICATIONS

CANOPY MUST MEET 2003 IBC, SEC. 3105 & 2003 IFC, CHAPTER 24
 CANOPY MUST MEET LATERAL & STRUCT. LOADS PER IBC CHAPTER 16
 STRUCT. MEMBERS MUST BE PROTECTED TO PREVENT DETERIORATION PER IBC SEC. 3105.3
 CANOPY FRAMES SHALL BE OF NON-COMBUSTIBLE MATERIAL, FIRE-RETARDANT-TREATED WOOD, OR WOOD OF TYPE IV SIZE (SEC. 3105.3)
 CANOPY MATERIAL SHALL BE FLAME RESISTANT IN ACCORDANCE WITH NFPA 701 OR HAS A FLAME SPREAD INDEX NOT GREATER THAN 25 (ASTM E 84).

SPRINKLER SYSTEM
 EXTEND EXISTING SPRINKLER LINES & HEADS UNDER CANOPY AREAS TO MEET CODE



Number	Date	By	Description of Revisions

Scale AS SHOWN (HALF SCALE AT 11X17)
 Designed AER Drawn AER
 Date FEB 3, 2006 Checked AER
 Approved By AER Job Number 0602
 Sheet Title
FLOOR PLANS